

Fig.1

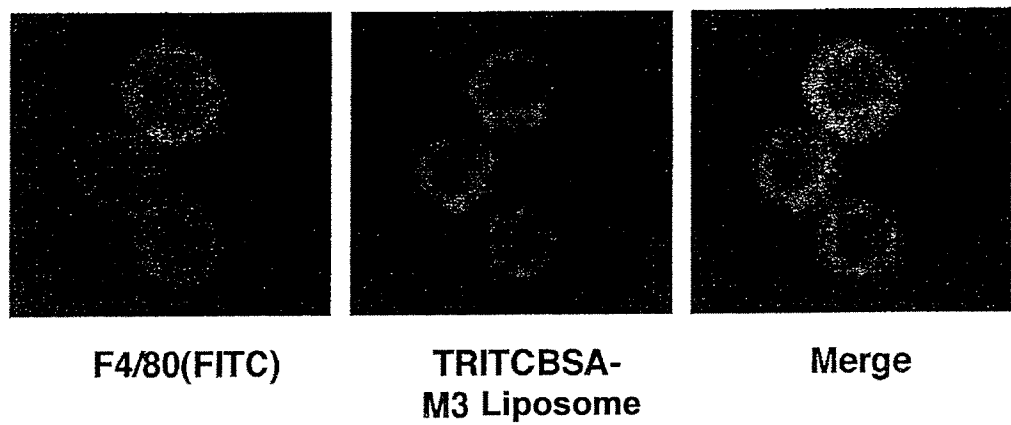
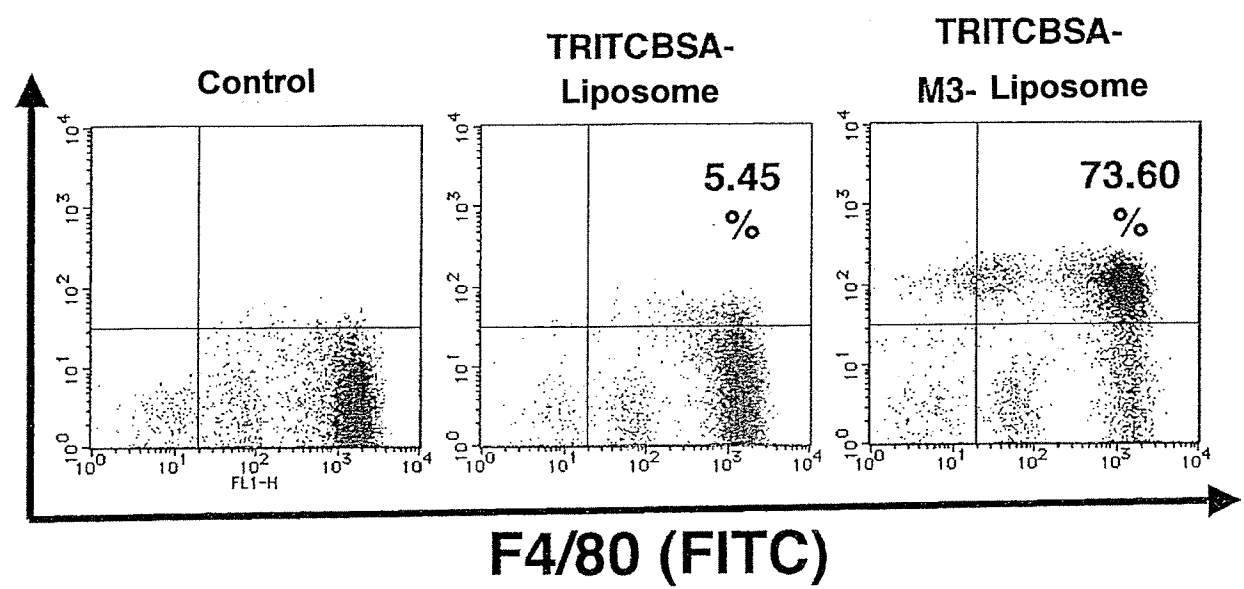


Fig.2

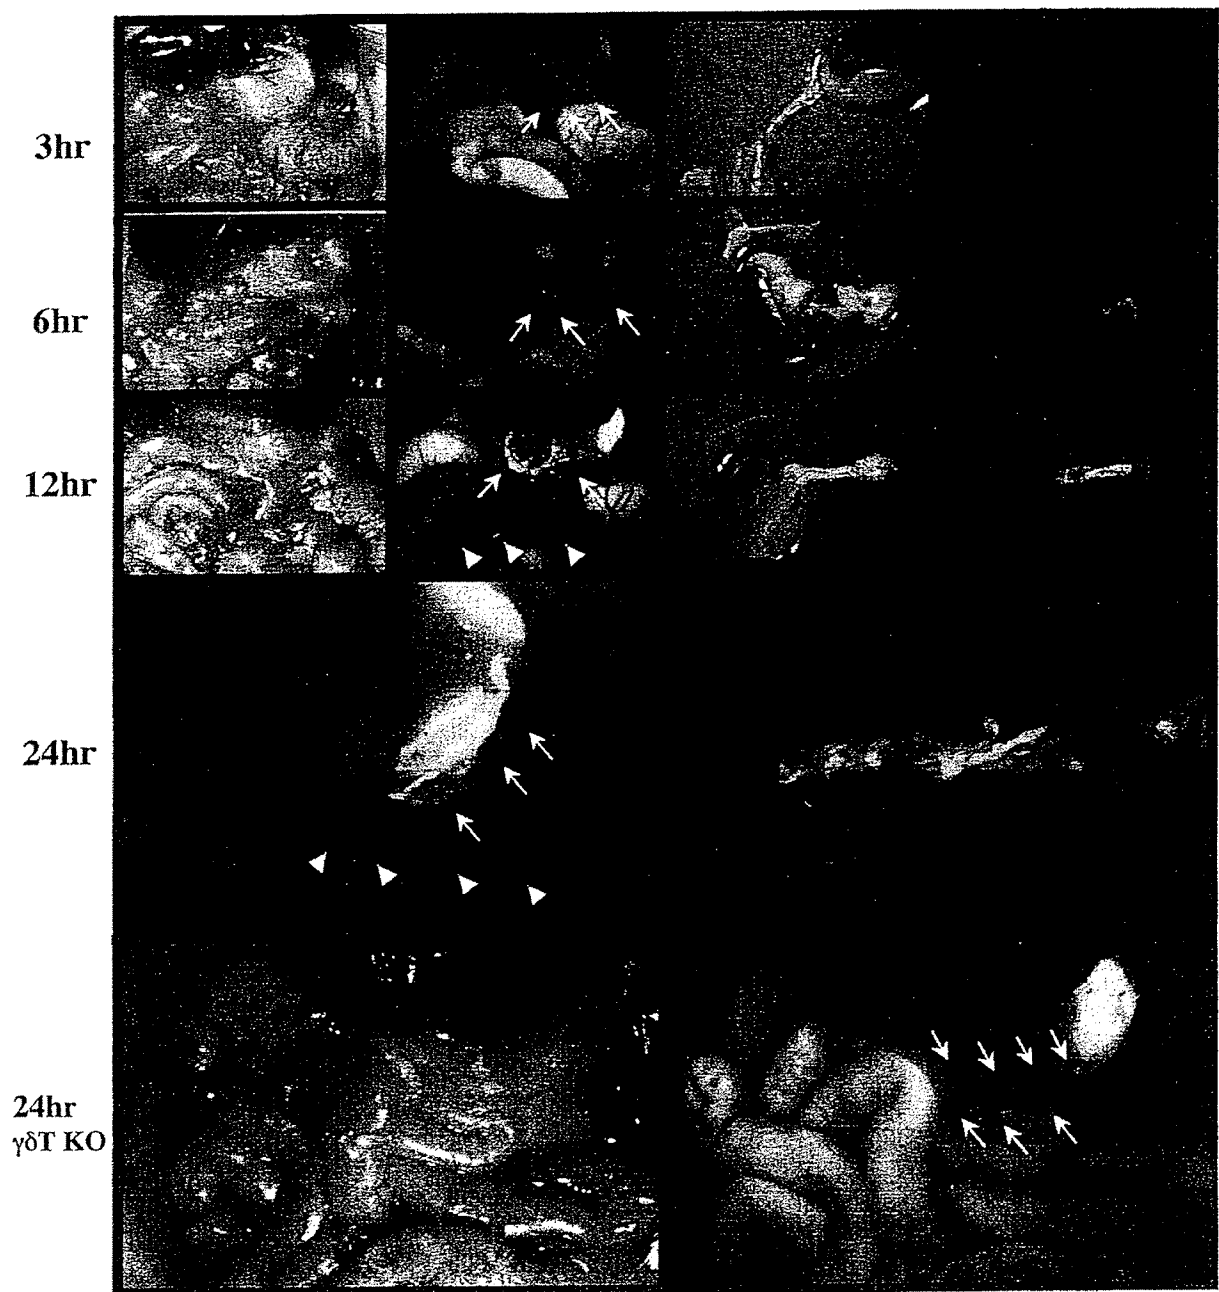


Fig.3


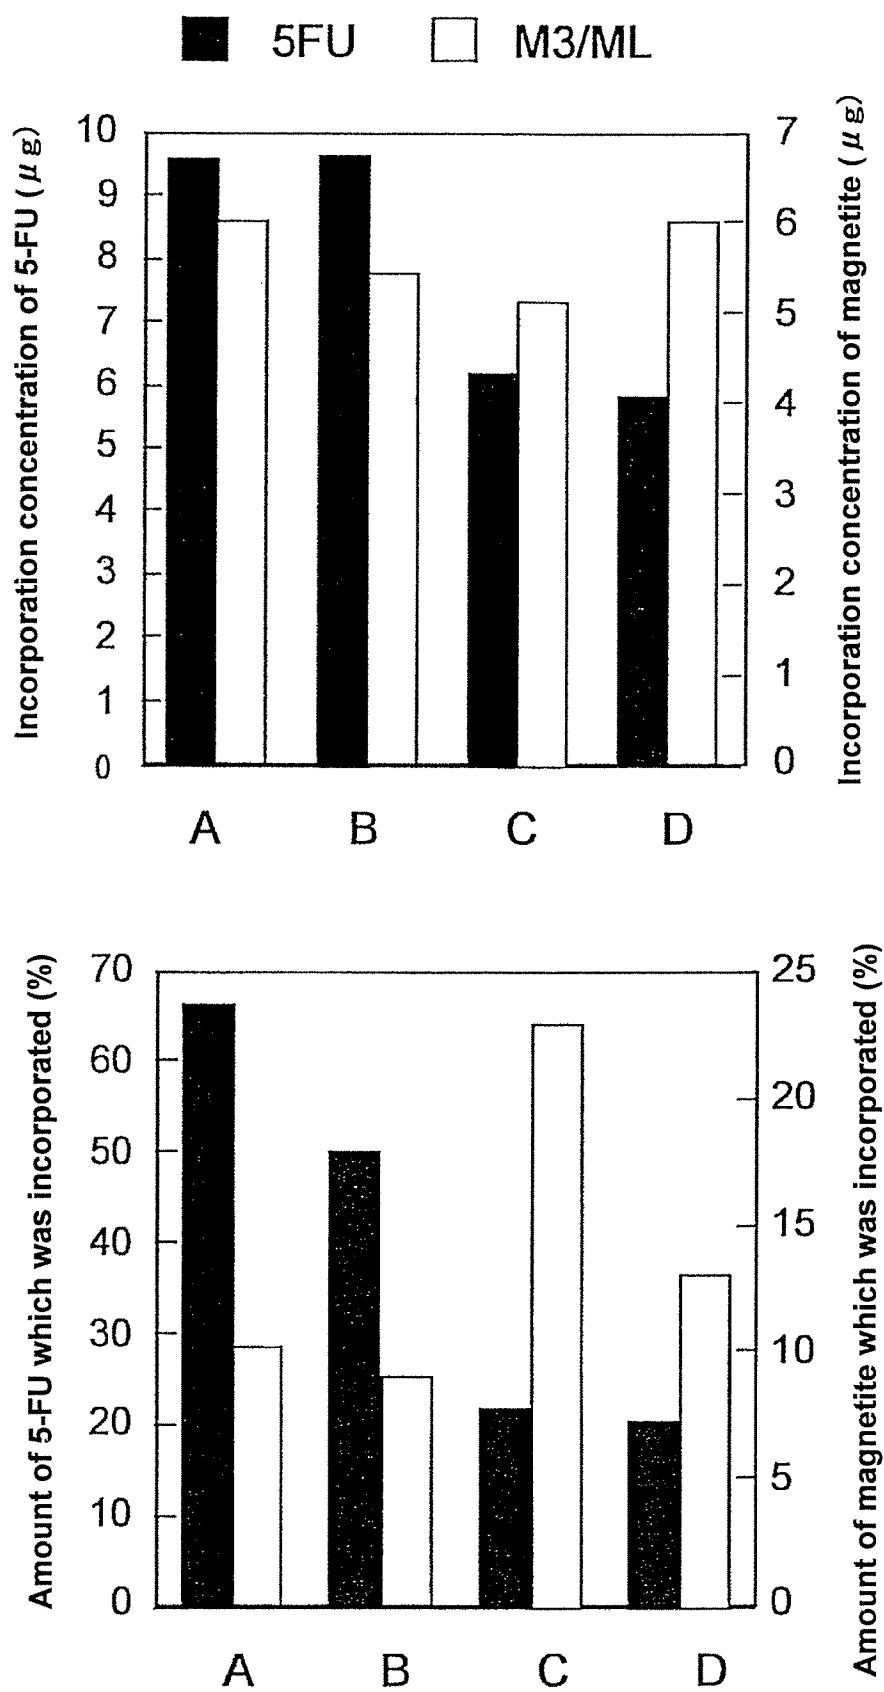


Fig.4

**5FU/MCL treatment
(5FU, 14.4 μ g)**

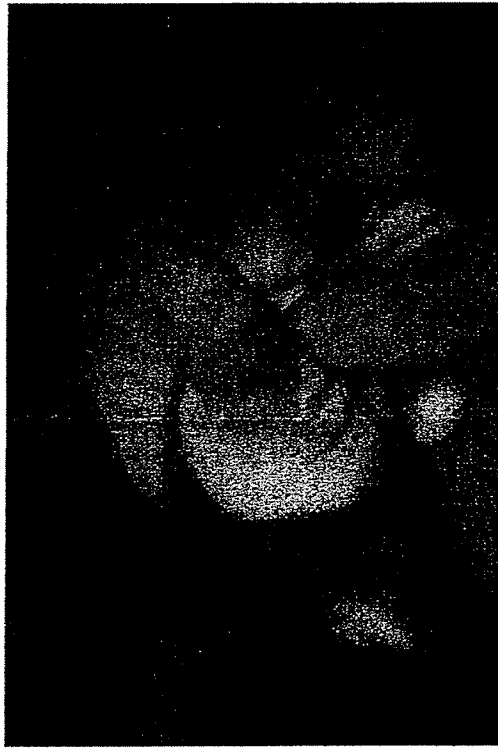

Control

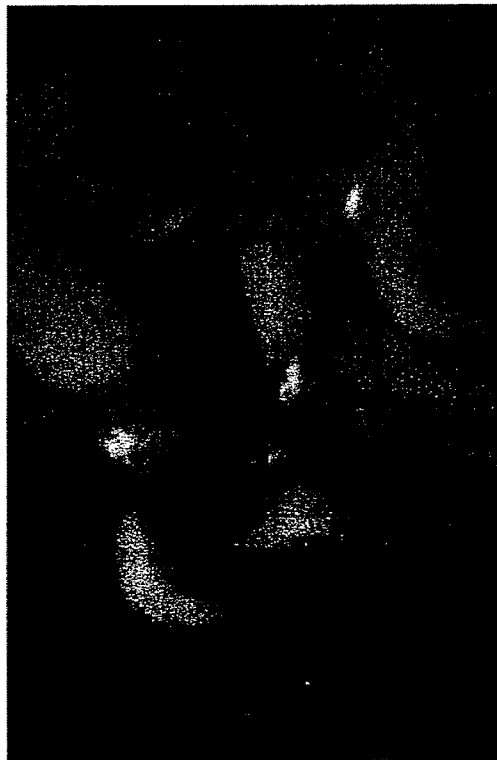


Fig.5

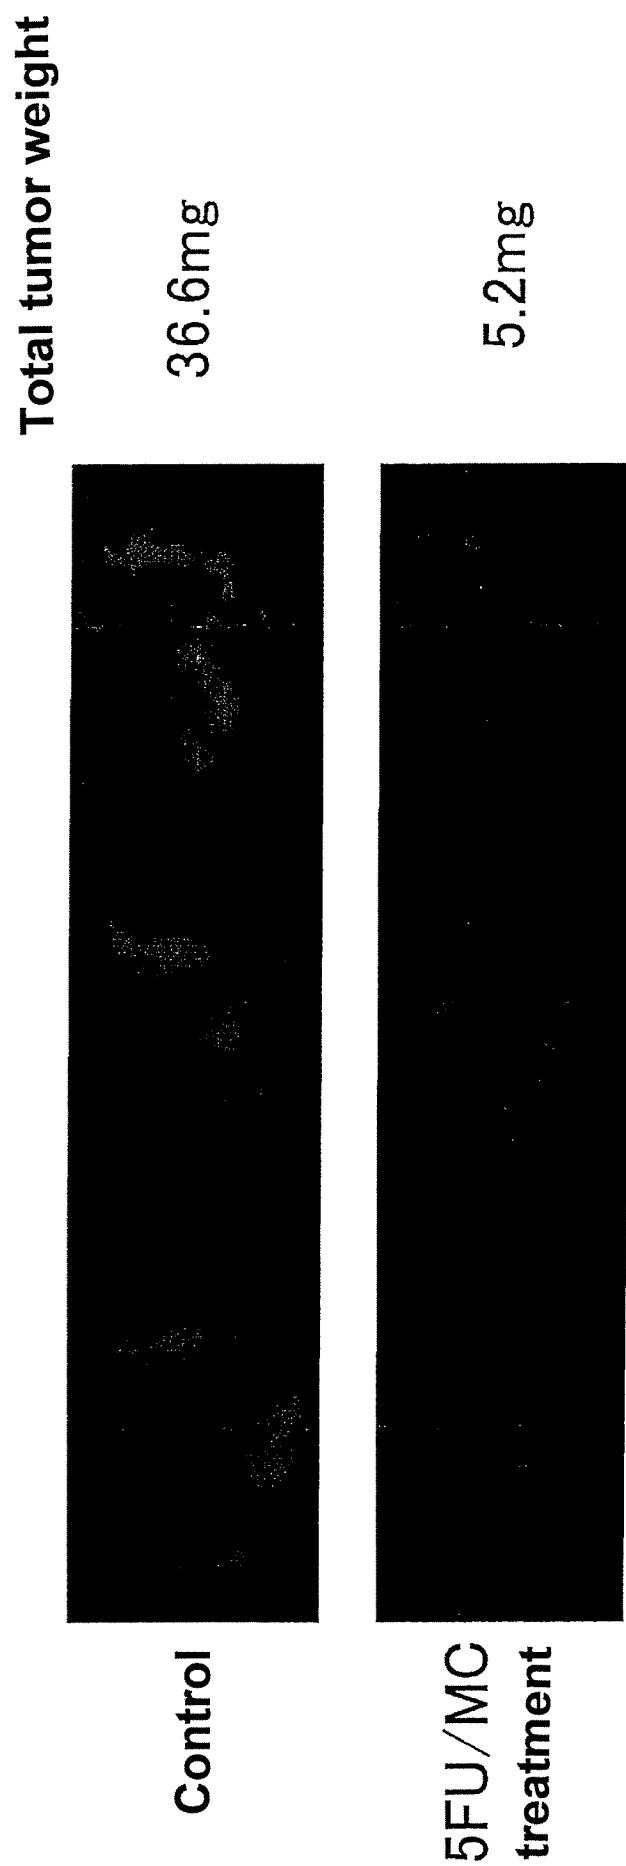


Fig.6

